


DEACON STATION PLAN VIEW (EL. 229.8 m)
 SCALE: 1:100

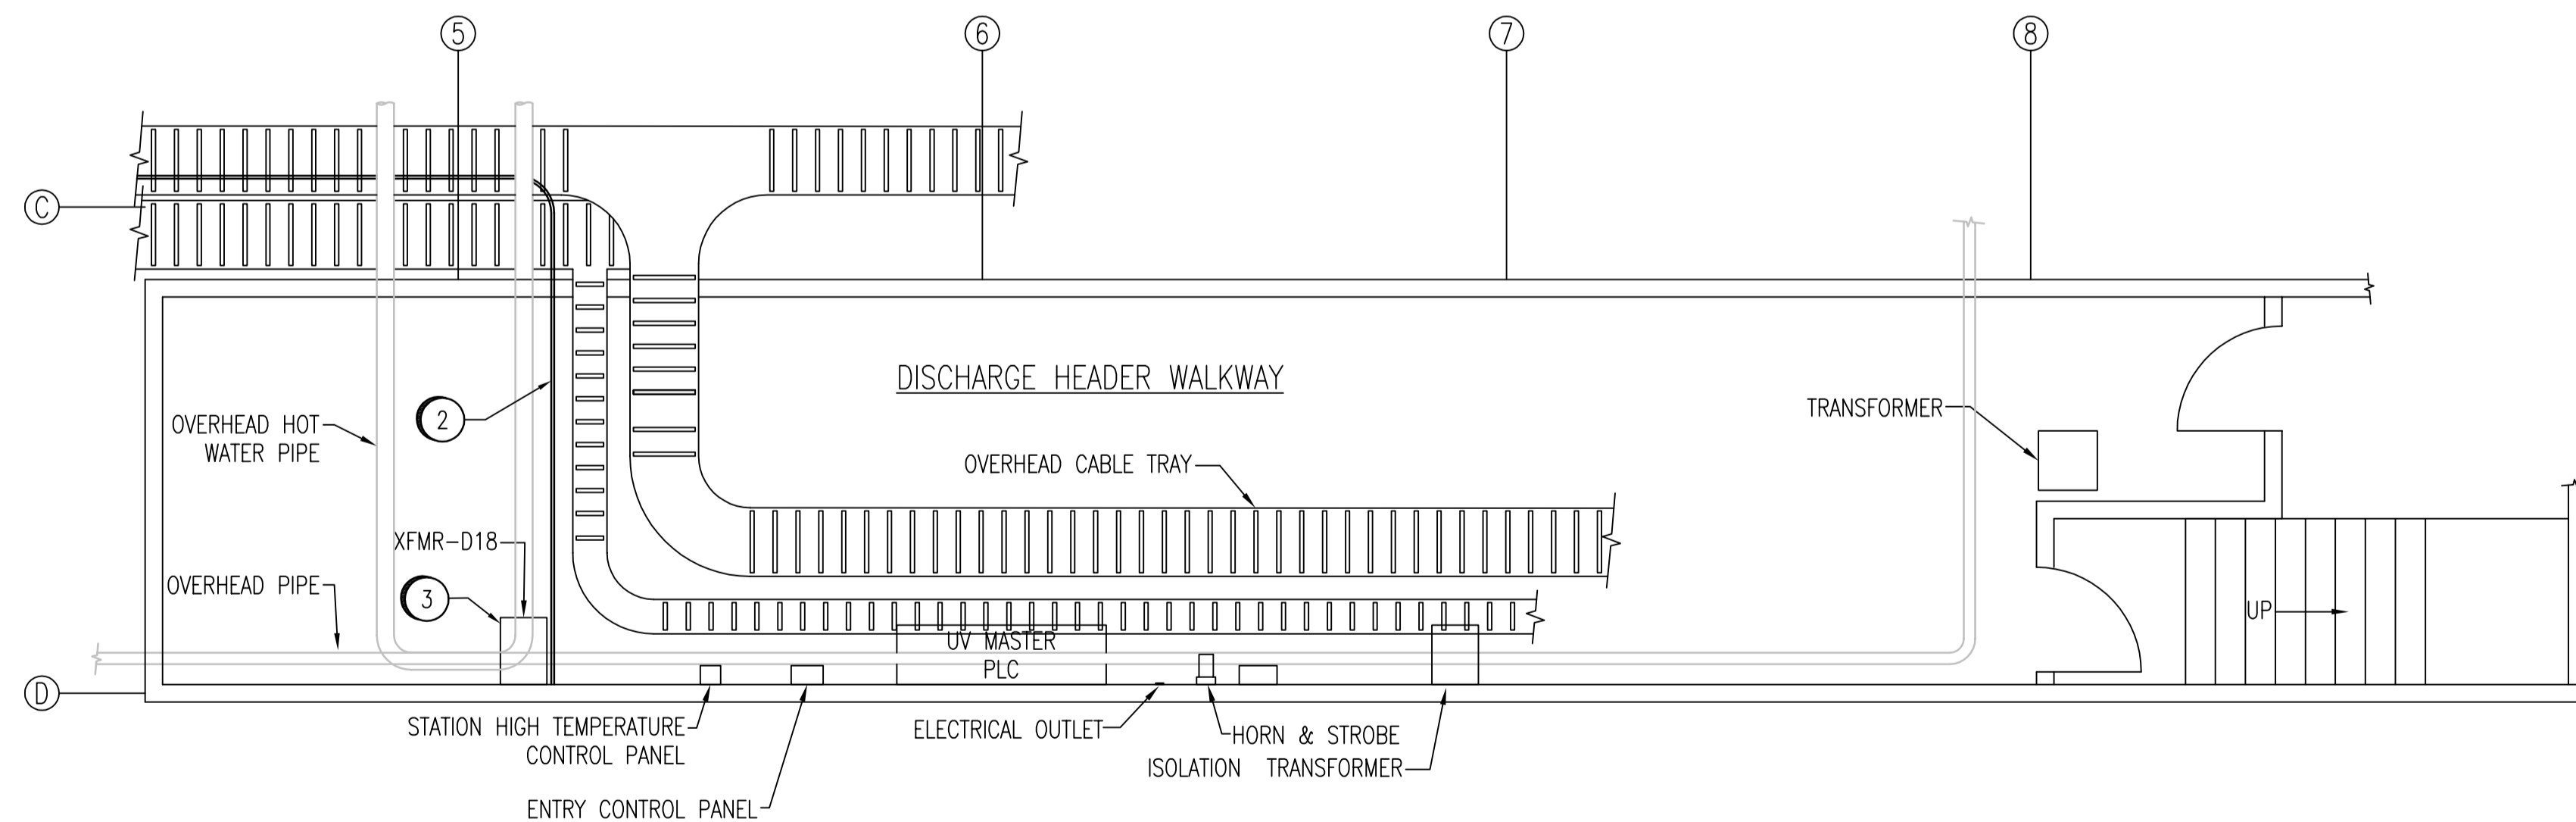

DISCHARGE HEADER WALKWAY PLAN
 SCALE: 1:50

NO.	CONSTRUCTION NOTES
1	ROUTE CABLE XFMR-D18-P IN EXISTING POWER CABLE TRAY AFTER INVESTIGATING AND CONFIRMING THE LOAD CAPACITY OF THE EXISTING CABLE TRAY.
2	STRAP TECK CABLE XFMR-D18-P TO CEILING AND WALL FOR FINAL CONNECTION TO XFMR-D18 AS SHOWN. CEILING CLAMPS SHALL BE PLACED A MAXIMUM OF 500mm APART.
3	INSTALL XFMR-D18 ON THE DISCHARGE HEADER WALKWAY. GROUND XFMR-D18 WITH A SEPARATE 6 AWG BARE COPPER WIRE TO THE STATION GROUND. DO NOT CONNECT TO A COMMON GROUNDING CONDUCTOR SMALLER THAN 2/0 AWG.

DRAWING NUMBER	REFERENCE DRAWINGS
----------------	--------------------

APECM
 Certificate of Authorization
 SNC-Lavalin Inc. (MB)
 No. 4489 Expiry: April 30, 2008

B.M. ELEV.	FIELD BOOK #:	SNC-LAVALIN INC. 148 Nature Park Way Winnipeg, MB, Canada R3P 0X7 204-786-8000
POSTED TO LBIS		
DESIGNED BY C. REIMER	CHECKED BY C. REIMER	ENGINEER'S SEAL PRELIMINARY NOT TO BE USED FOR CONSTRUCTION
DRAWN BY E. BOHNCKE	APPROVED BY C. REIMER	
HOR. SCALE 1:100	RELEASED FOR CONSTRUCTION	THE CITY OF WINNIPEG WATER AND WASTE DEPARTMENT DEACON BOOSTER PUMPING STATION UPS UPGRADES PLAN VIEW ELEVATION 229.80
VERTICAL 1:100	DATE 2007/10/24	
0 ISSUED FOR TENDER	2008/01/08 AEO	CITY DRAWING NUMBER
NO. REVISIONS	DATE BY	1-0620D-E0003
	FILENAME: 1-0620D-E0003-001-00.dwg	SHEET
		001
		REV.
		0
		SIZE
		A1