



| | | | | | | | |
|--|---------------------|--|------------------------|--|------------|--|-------------------------|
| | CI WM | | REPAIR 5-15YRS-ABANDON | | AQUEDUCT | | HISTORICAL PROJECT |
| | PVC WM | | REPAIR >15YRS | | MANHOLE | | SCHOOL |
| | AC WM | | REPAIR >15YRS-ABANDON | | SEWERS | | PWD PROJECT |
| | UNKNOWN WM | | VALVE | | RAILWAY | | SEWER RELIEF WORK |
| | REPAIR <5YR | | HYDRANT | | WM RENEWAL | | CATHODIC PROTECTION |
| | REPAIR <5YR-ABANDON | | HYDRANT BRANCH | | WM NEW | | FIRE PROTECTION UPGRADE |
| | REPAIR 5-15YRS | | FEEDER MAIN | | WM ABANDON | | |


Additional Notes:
 -200mm ok

N

Printed: 9/16/2021

CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2022 WATER MAIN RENEWAL PROGRAM


| | |
|--|----------------------------|
| Location ID: 3 | Street: HARTFORD AVE |
| Location Description: SALTER ST TO MAIN ST | |
| Scale: 1:2000 | Renewal Type: REPAIR COUNT |

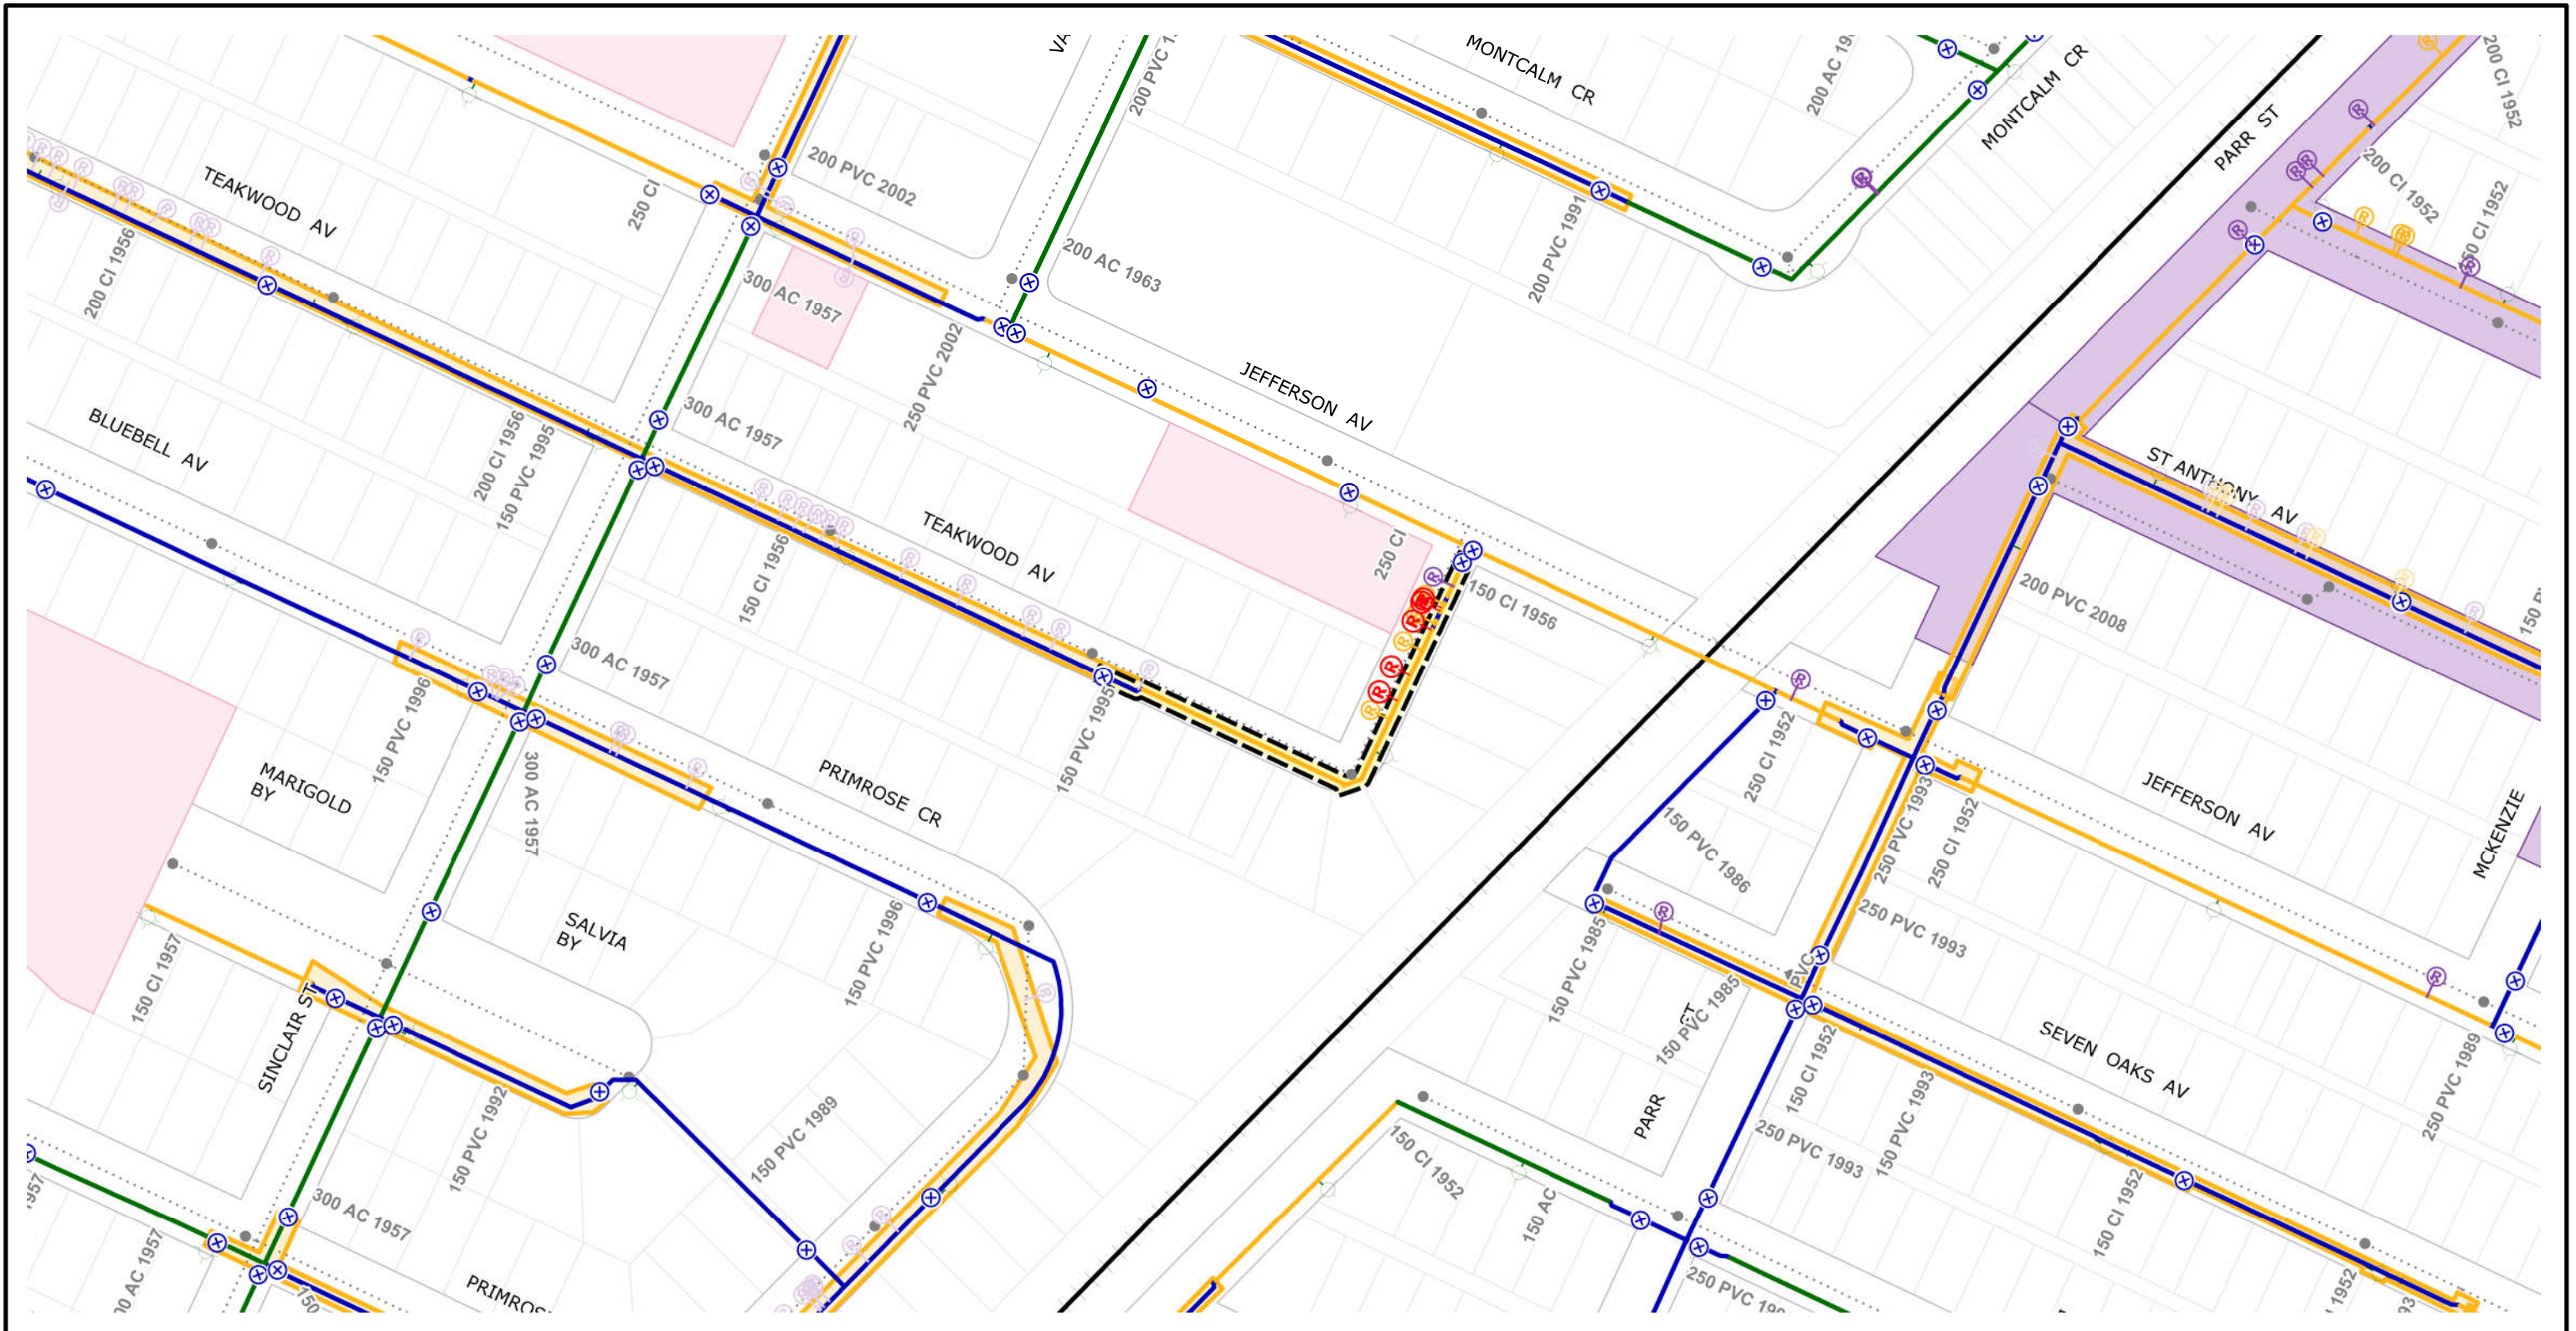

| | | | | | | | |
|--|----------------------|--|------------------------|--|------------|--|-------------------------|
| | CI WM | | REPAIR < 5YRS | | AQUEDUCT | | HISTORICAL PROJECT |
| | PVC WM | | REPAIR > 15YRS | | MANHOLE | | SCHOOL |
| | AC WM | | REPAIR > 15YRS-ABANDON | | SEWERS | | PWD PROJECT |
| | UNKNOWN WM | | VALVE | | RAILWAY | | SEWER RELIEF WORK |
| | REPAIR < 5YR | | HYDRANT | | WM RENEWAL | | CATHODIC PROTECTION |
| | REPAIR < 5YR-ABANDON | | HYDRANT BRANCH | | WM NEW | | FIRE PROTECTION UPGRADE |
| | REPAIR 5-15YRS | | FEEDER MAIN | | WM ABANDON | | |


Additional Notes:
 -150mm ok
 -Adjacent to Faith Academy Middle School

Printed: 9/16/2021



CITY OF WINNIPEG WATER AND WASTE DEPARTMENT 2022 WATER MAIN RENEWAL PROGRAM


| | |
|--|----------------------------|
| Location ID: 14 | Street: TEAKWOOD AVE |
| Location Description: JEFFERSON AVE TO MID-BLOCK E | |
| Scale: 1:2000 | Renewal Type: REPAIR COUNT |

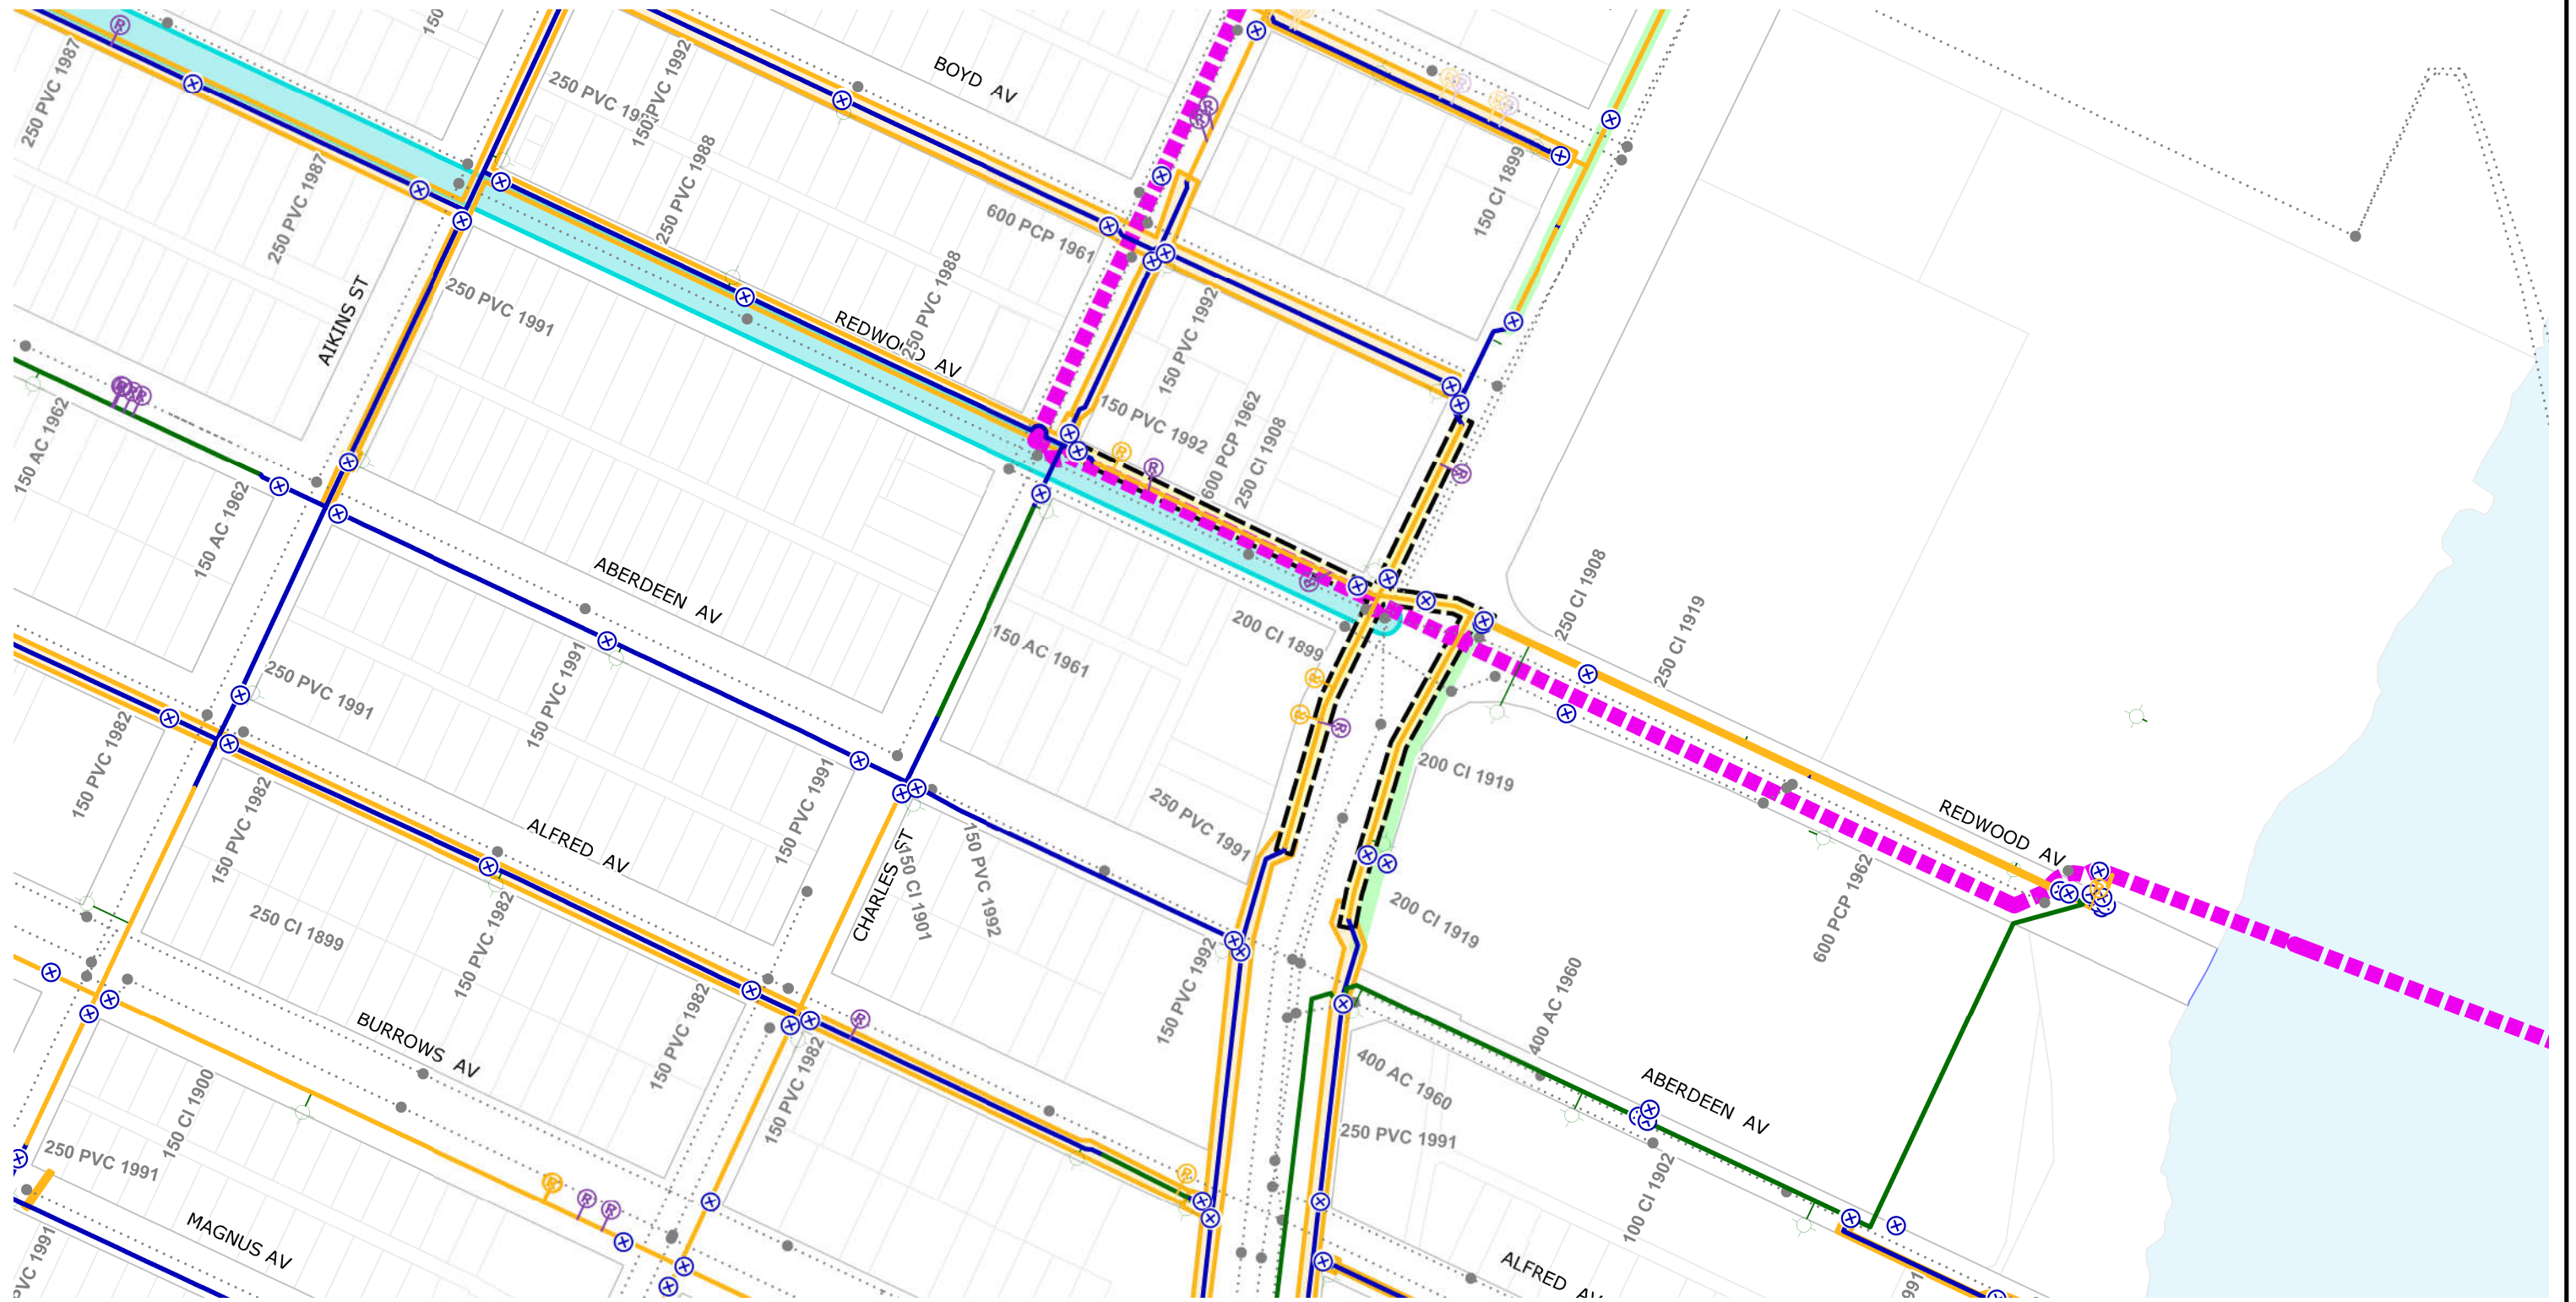

| | | | | | | | |
|--|---------------------|--|------------------------|--|------------|--|-------------------------|
| | CI WM | | REPAIR 5-15YRS-ABANDON | | AQUEDUCT | | HISTORICAL PROJECT |
| | PVC WM | | REPAIR >15YRS | | MANHOLE | | SCHOOL |
| | AC WM | | REPAIR >15YRS-ABANDON | | SEWERS | | PWD PROJECT |
| | UNKNOWN WM | | VALVE | | RAILWAY | | SEWER RELIEF WORK |
| | REPAIR <5YR | | HYDRANT | | WM RENEWAL | | CATHODIC PROTECTION |
| | REPAIR <5YR-ABANDON | | HYDRANT BRANCH | | WM NEW | | FIRE PROTECTION UPGRADE |
| | REPAIR 5-15YRS | | FEEDER MAIN | | WM ABANDON | | |

Additional Notes:
 -250mm on Redwood
 -200mm on Main





**CITY OF WINNIPEG
 WATER AND WASTE DEPARTMENT
 2022 WATER MAIN RENEWAL PROGRAM**

| | |
|--|------------------------------|
| Location ID: 25 | Street: REDWOOD AVE/ MAIN ST |
| Location Description: CHARLES ST TO MAIN ST/ BOYD AVE TO ABERDEEN AVE | |
| Scale: 1:2000 | Renewal Type: PWD-REGIONAL |